

ALTALINK

2611-3rd Ave. S.E.
Calgary, Alberta
T2A 7W7

December 13, 2007

WEIDMANN DIAGNOSTIC SOLUTIONS

110, 7304 30th Street S.E.
Calgary, Alberta
T2C 1W2

To the Calgary Weidmann Laboratory staff:


On behalf of AltaLink Management LTD, I would like to thank the Calgary Weidmann laboratory for their efforts in producing a timely dissolved gas analysis sample for TX 18557 upon request. Your rapid response helped to keep the lights on in the town of Airdrie.

The initial DGA results alerted AltaLink to a possible tap changer concern. The second sample, which was brought to your lab on Tuesday, December 4th, 2007, confirmed the initial results and provided insight into the need for immediate AltaLink response. The dissolved gas analysis results were provided to AltaLink within an hour and a half of submitting the sample. This response time is truly commendable and widely appreciated.

I have included pictures of what was discovered in the tap changer compartment of TX 18557. The butterfly contacts in the reversing switch were severely damaged due to excess heating and coking.

We are thankful for your hard work and continuous support.

Sincerely,

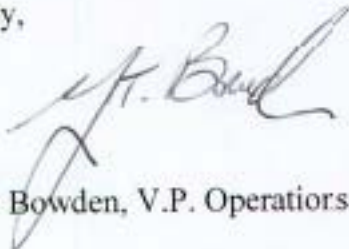

George Bowden, V.P. Operations & Maintenance, Chief Engineer

